


GENERAL NOTES

1. REFER TO DRAWING E101 FOR GENERAL NOTES.

KEY NOTES

- 1 NOT USED
- 2 DUAL TECHNOLOGY OCCUPANCY SENSORS TO CONTROL VAV TERMINALS AND LIGHT FIXTURES
- 3 THIS CIRCUIT TO BE CONNECTED TO TIMER CLOCK AS IN THE MAIN ELECTRICAL ROOM
- 4 ALL LIGHT FIXTURE TYPES (A, A, W, N, L, S, P, R, T, C, D) TO BE CONNECTED TO THE SAME CIRCUIT (PANELS 4-1) IN ORDER FROM LOW VOLTAGE LAMPS TO BE CONTROLLED BY ONE OTHER SWITCH.
- 5 CEILING MOUNTED RECEPTACLES (TYPICAL FOR A LOCATION) TO BE USED FOR THE CONNECTION OF PHOTOGRAPHY LIGHTS FROM UP

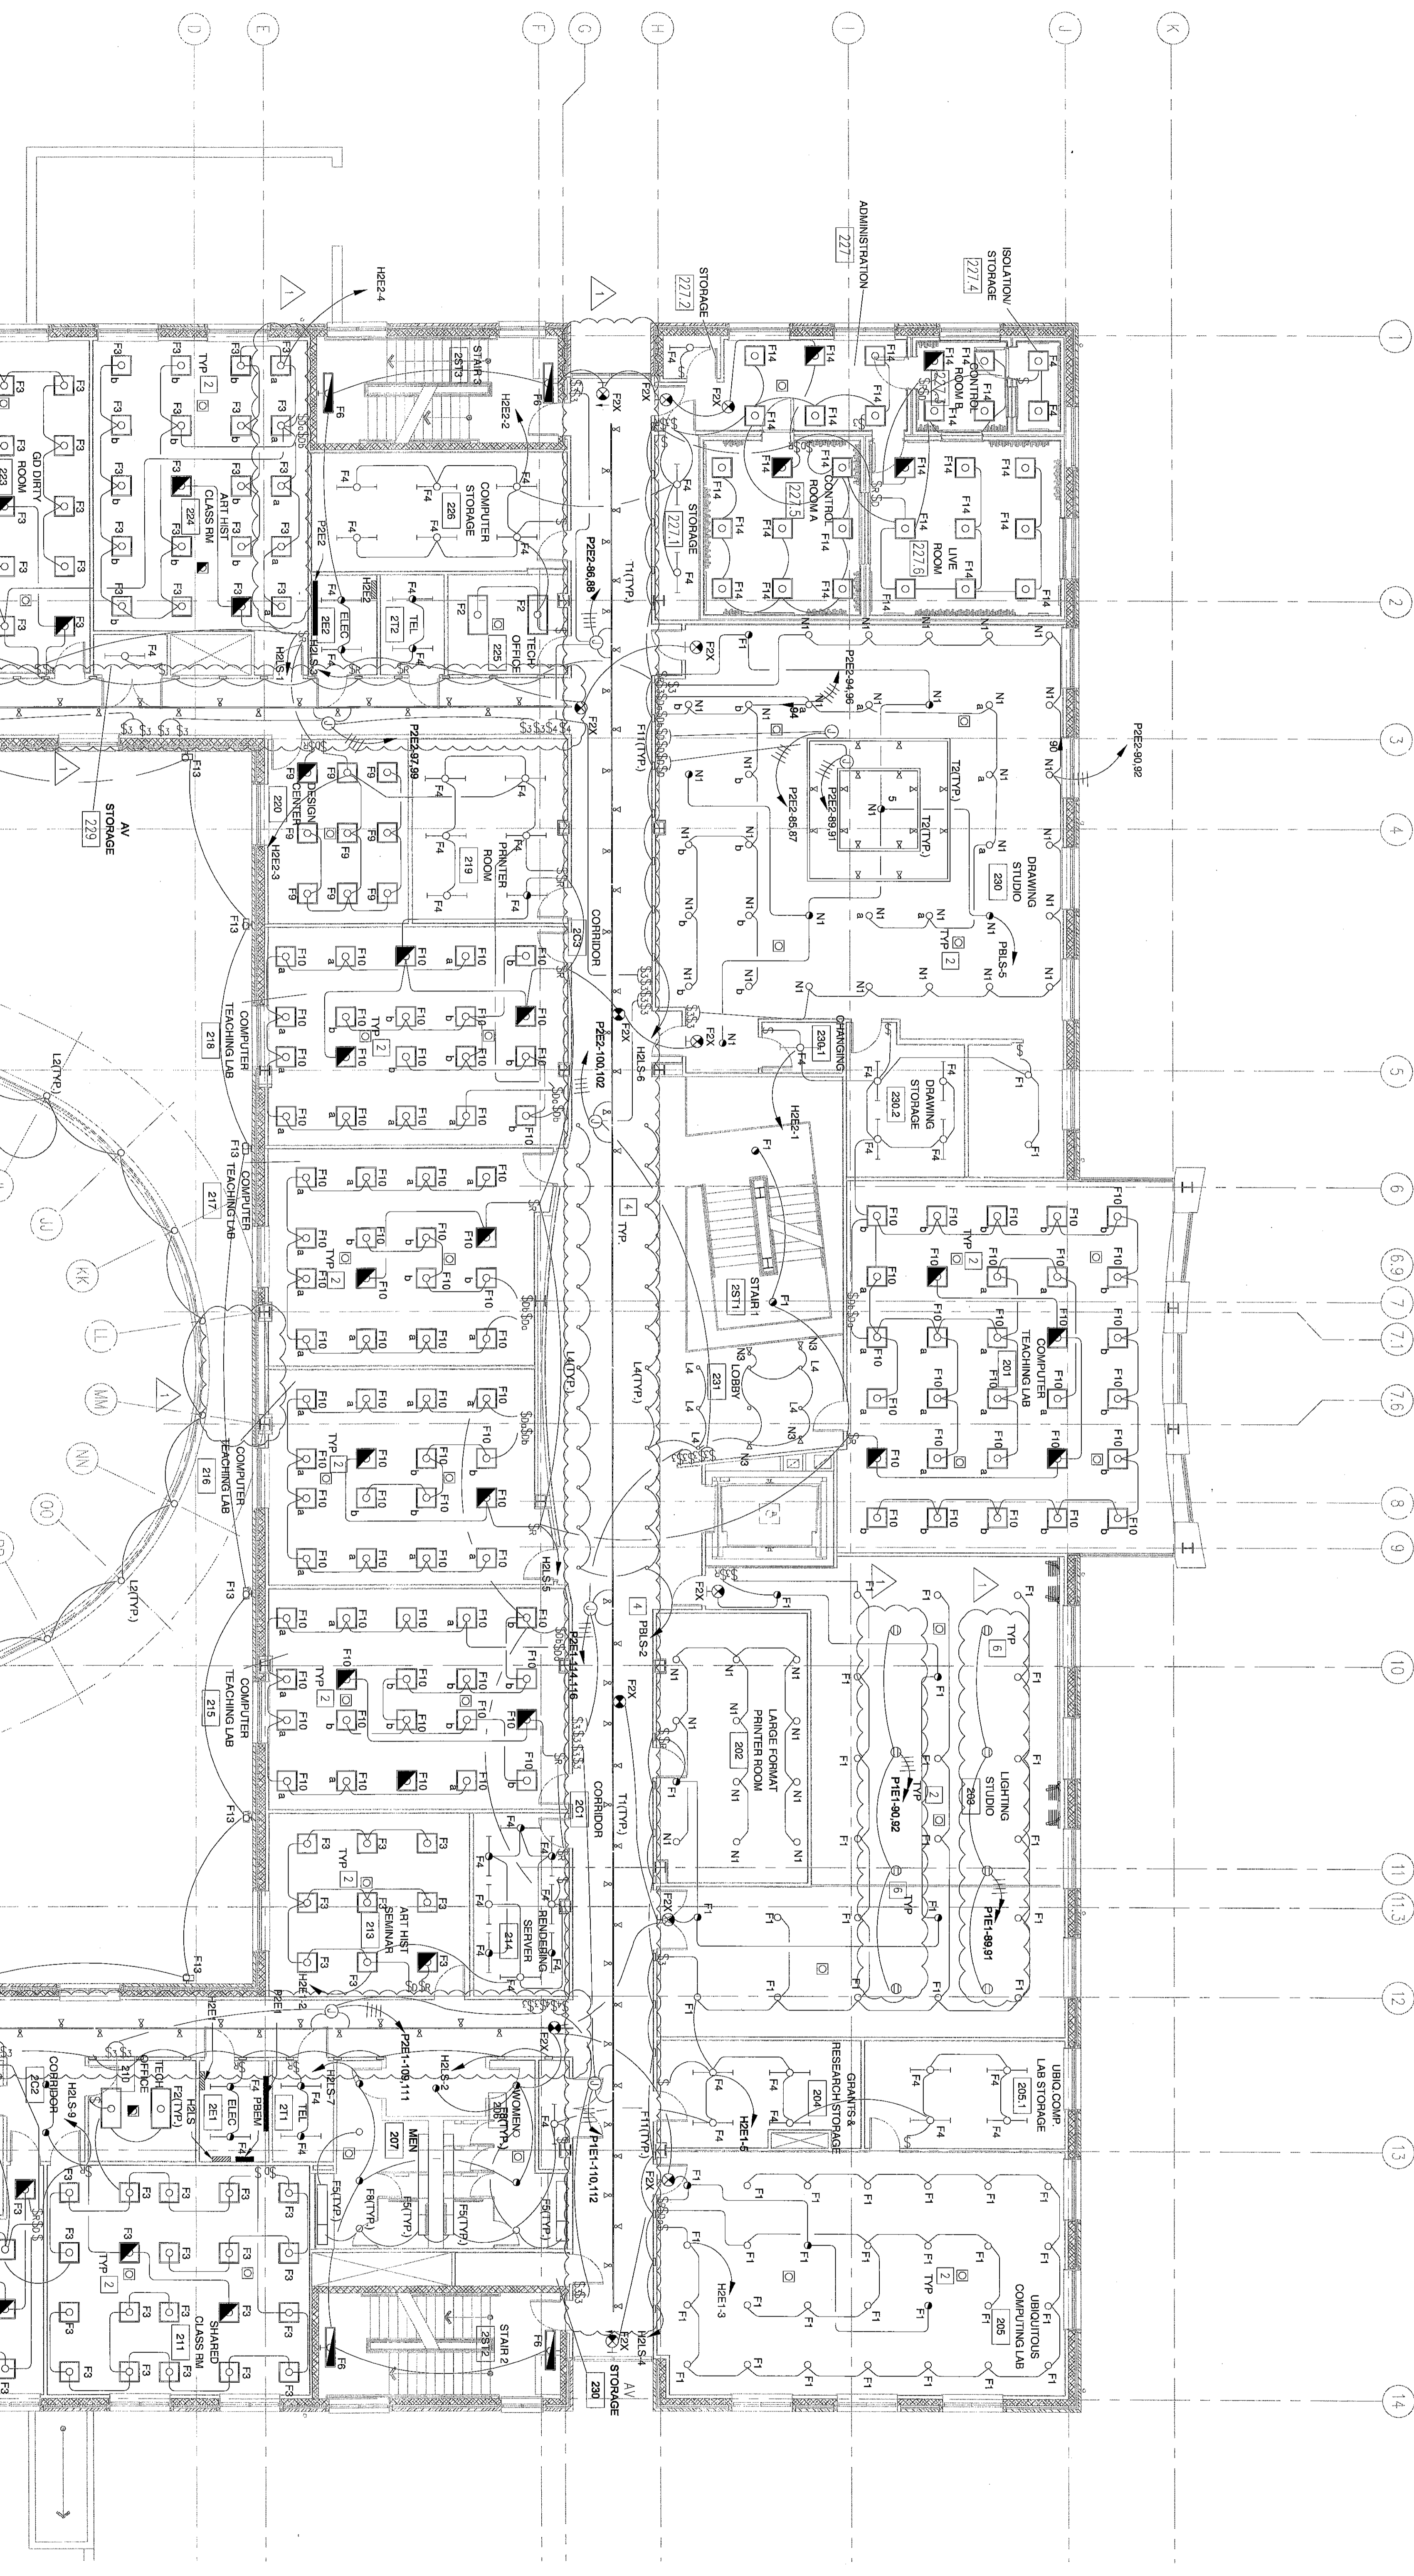

1 ELECTRICAL-LIGHTING SECOND FLOOR

1/8"=1'-0"

ADDENDUM #3 4.1.2008
 NO. REVISION/SUBMISSION DATE

THE COLLEGE OF NEW JERSEY
New Art & IMM Building
 Ewing, New Jersey

DATE: 2.20.2008
 SCALE: 1/8"=1'-0"
 EYP PROJECT NO. 1006041.01
 DESIGNED BY: MC
 DRAWN BY: MC
 CHECKED BY: EN

ELECTRICAL-LIGHTING
SECOND FLOOR

KEY PLAN: