


eyep.com

- GENERAL NOTES**
1. REFER TO MECHANICAL EQUIPMENT CONNECTION SCHEDULE ON ESD/WHIRL WIRING DETAIL.
 2. REFER TO MECHANICAL AND PLUMBING DRAWINGS FOR EXACT EQUIPMENT LOCATION.

KEY NOTES

1. DUPLEX RECEPTACLE WITH SPRING RETRACTABLE POWER CORD WITH LENGTH OF 50 FEET MINIMUM. REFER CHART OR DRAWING FOR EXACT COORDINATE DETAILS WITH FACILITY.
2. POWER FOR CAMERAS.
3. CEILING MOUNTED RECEPTACLES FOR SERVERS.
4. PROVIDE STAIR UP FOR THE QUAD RECEPTACLES FOR THE DRAWING STORAGE.
5. WIRED THROUGH FLOOR TO OUTLETS IN TABLE COORDINATE LOCATION WITH COLLEGE OF NEW JERSEY.
6. WIRED THROUGH FLOOR TO OUTLETS IN THE ROOM.
7. PROVIDE EXISTING 400V FUSED DISCONNECT SWITCH AND 80VA UPS WITH THE FOLLOWING BULLETIN WITH IN THE SAME ENCLOSURE SIMILAR TO MITSUBISHI MODEL 701A SERIES OR 1.0 HOURS BATTERY.
8. 2. 10 MINUTES BATTERY.
9. OUTPUT PANEL BOARD WITH AT LEAST 100A 1 POLE BREAKERS.
8. CONNECT THESE CIRCUITS TO THE BREAKERS OF UPS OUTPUT PANEL.

KEY PLAN:

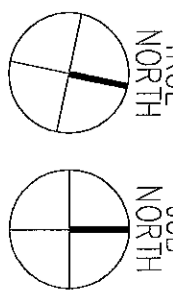

NO.	REVISION/SUBMISSION	DATE
1	ADDENDUM #3	4.1.2008

THE COLLEGE OF NEW JERSEY

New Art & IMM Building

Ewing New Jersey

DATE: 2.20.2008
 SCALE: 1/8"=1'-0"
 EYP PROJECT NO. 1006041.01
 DESIGNED BY:
 DRAWN BY:
 CHECKED BY: EN

ELECTRICAL-POWER SECOND FLOOR

1/8"=1'-0"

